
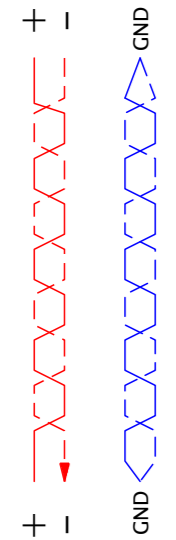
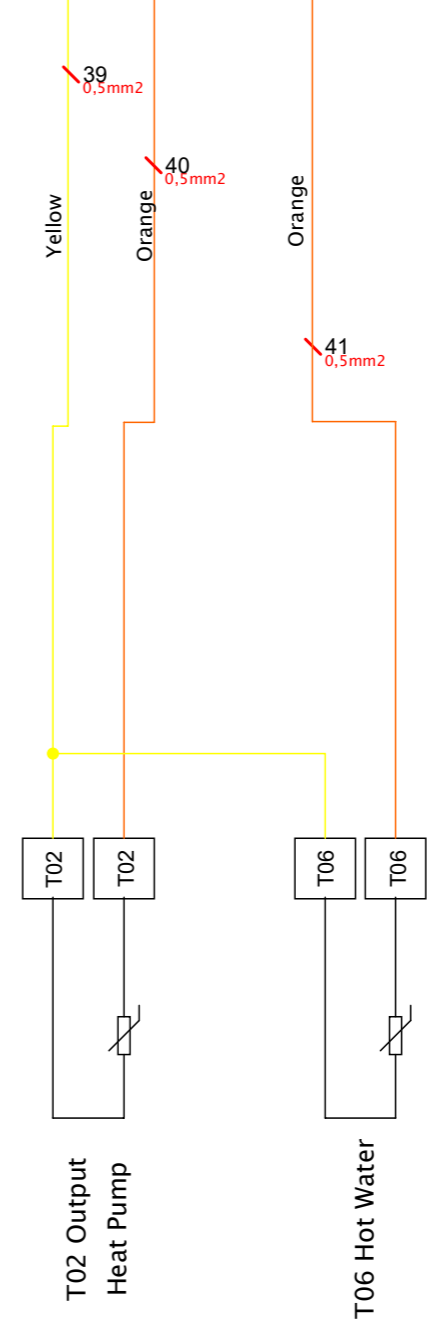
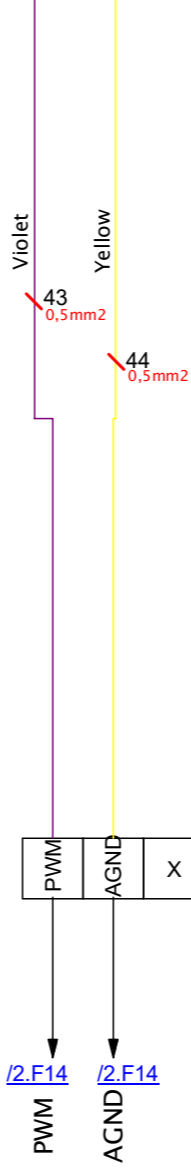
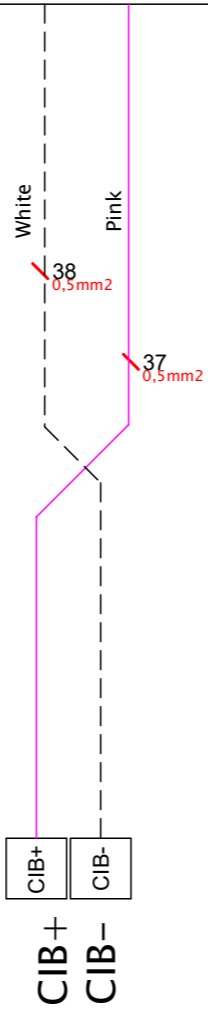
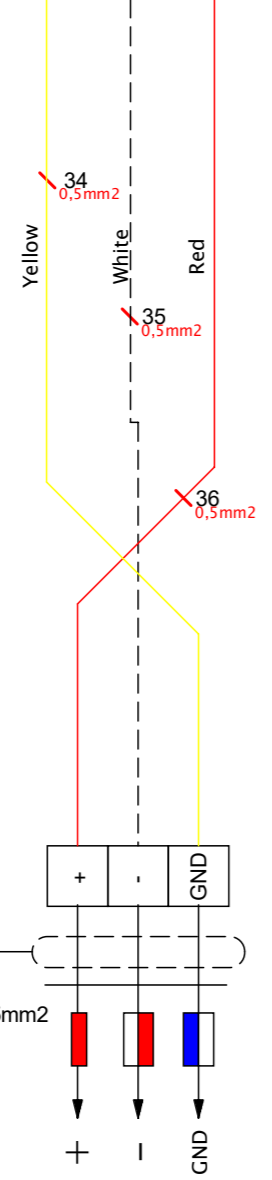
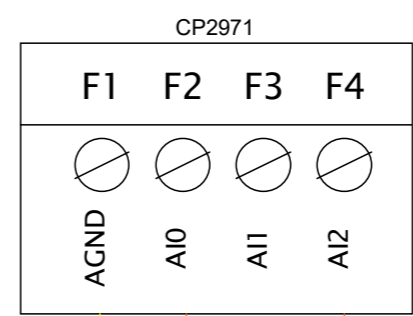
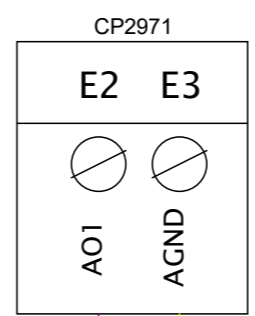
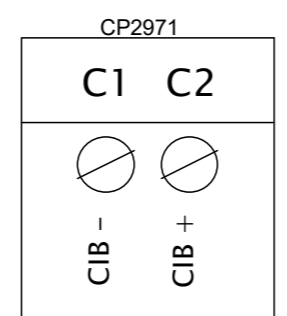


Indoor Unit

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18

A
B
C
D
E
F
G
H
J
K
L
M

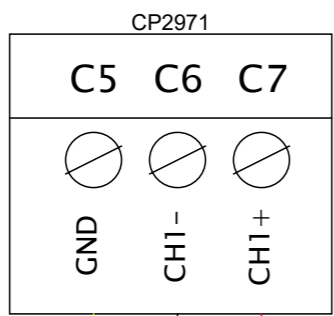

+ - must be one pair (red with white)
GND blue-white pair into one clamp

Communication
MODBUS

Room
Thermostat

Circ. pump
Heat Pump


T02 Output
Heat Pump

T06 Hot Water



Author Petr Řezba	Document type el. diagram	Department V3	Technical officer	Title, supplementary title TC PRO-N-2971 wiring diagram	Document no. 2021140103	Release date 12.8.2021	Language EN	Changes	Sheet 1
----------------------	------------------------------	------------------	-------------------	---------------------------------------------------------------	----------------------------	---------------------------	----------------	---------	------------

Indoor Unit

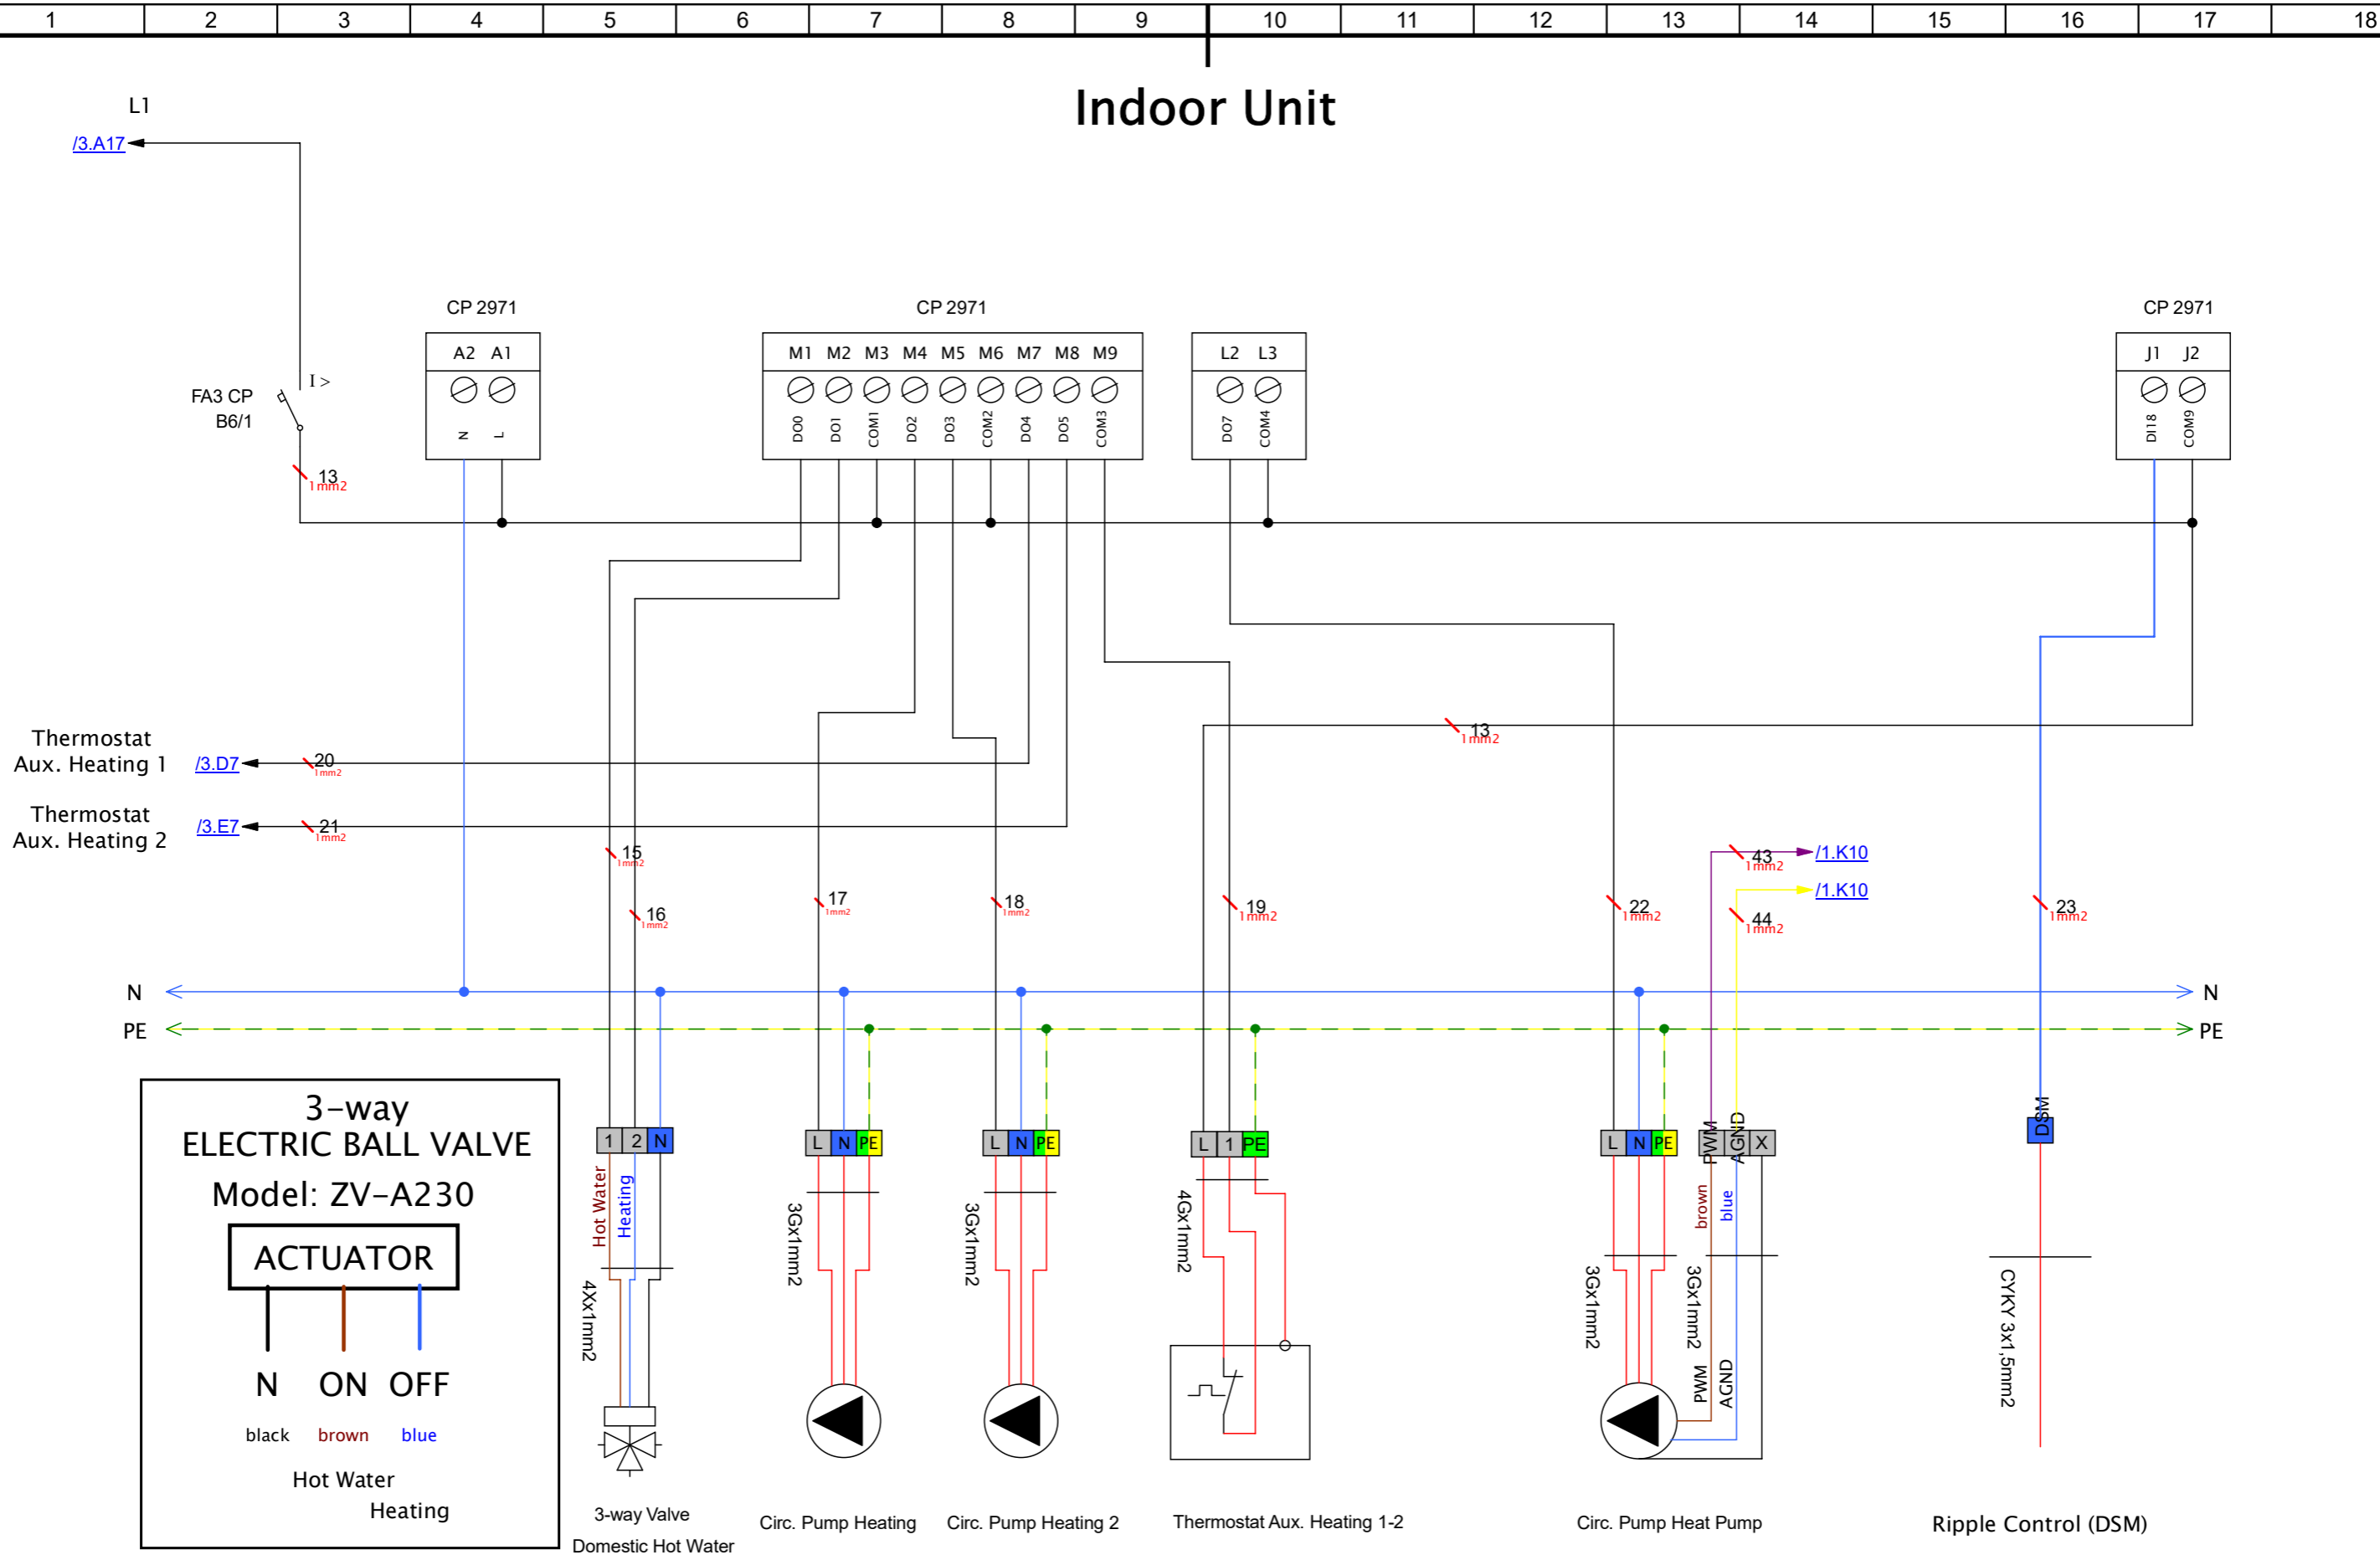

Indoor Unit

